



ZONE 3

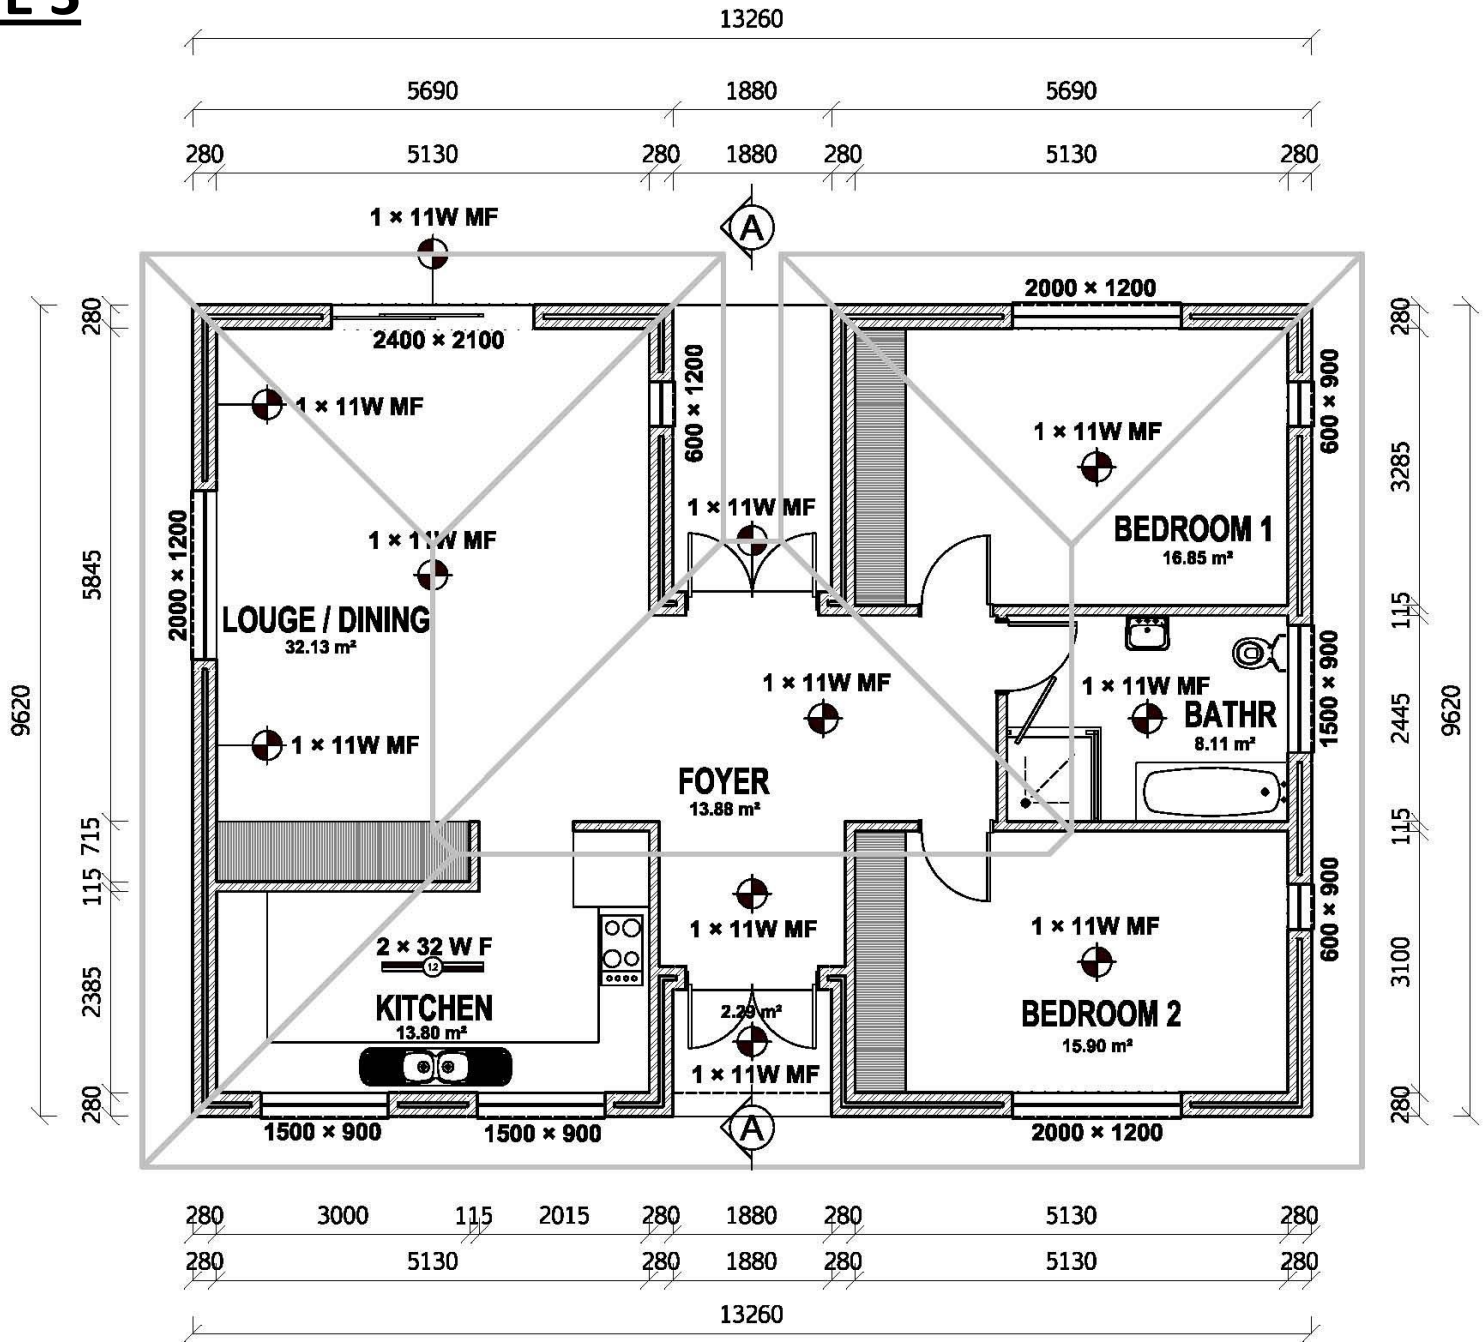

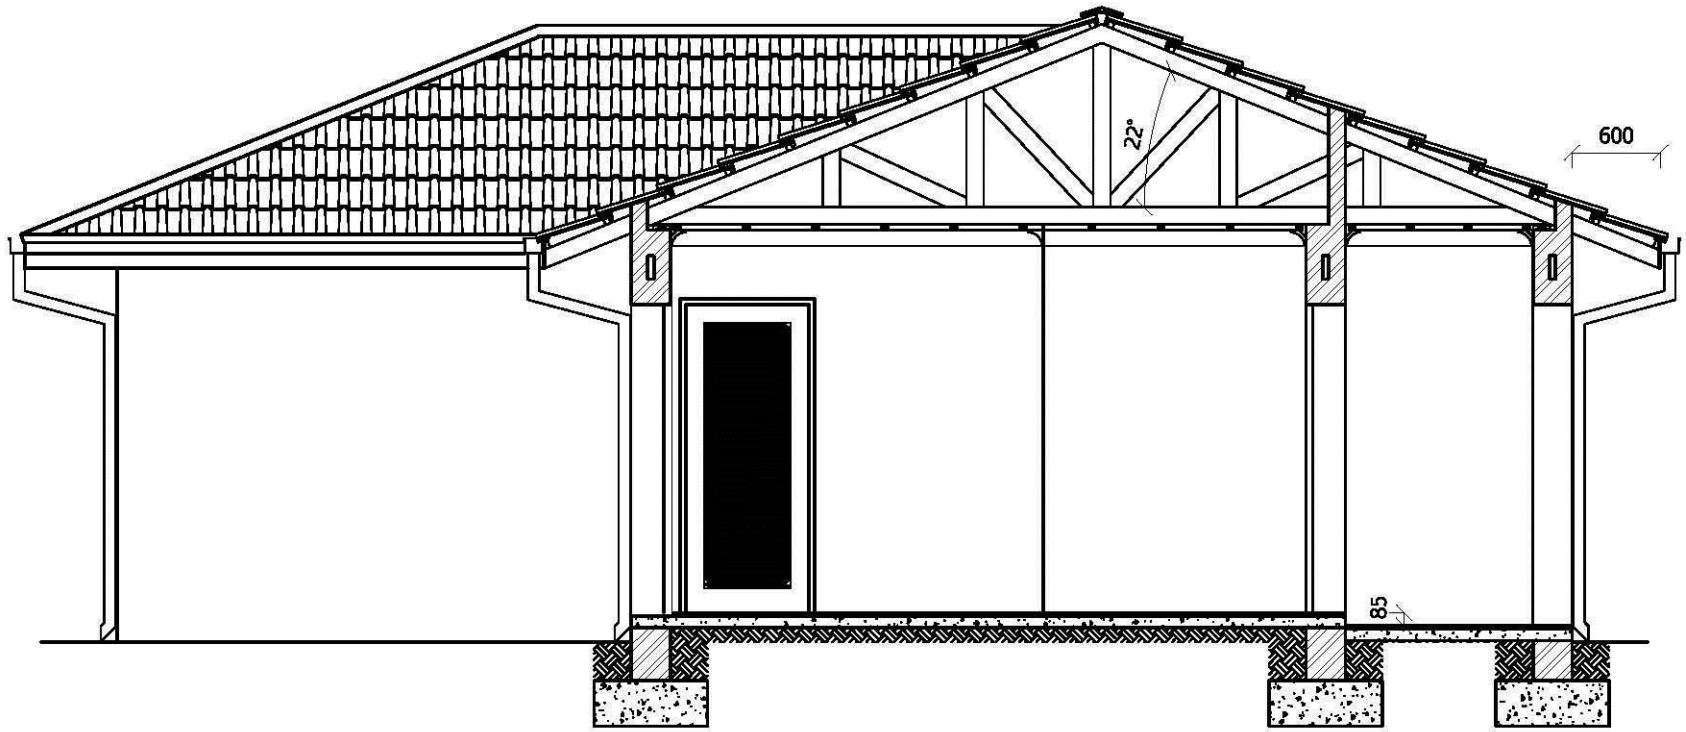

2100
2550
2275

NATURAL VENTILATION

CONSTANTS:

$$\text{CONDUCTANCE:} \quad 100.67 \times 1.4 = 140.94$$

$$\text{SHG:} \quad 100.67 \times 0.10 = 10.07$$

CONDUCTANCE:

Use clear glass in aluminium split frame

$$\begin{aligned} A \times U &= 18.09 \times 5.6 \\ &= 101.30 \quad (< 140.94 \checkmark) \end{aligned}$$

SOLAR HEAT GAIN:

$$P = 600 + 115 = 715$$

$$G = 2275 - 2100 = 175 \quad (< 500)$$

2100 Door:	$P/H = 715/2275 = 0.31$
1200 Window:	$P/H = 715/1375 = 0.52$
900 Window:	$P/H = 715/1075 = 0.66$

NORTH:

$5.04 \times 0.77 \times 0.35$	$= 1.36$
$2.40 \times 0.77 \times 0.30$	$= 0.55$

EAST:

$(0.54 \times 0.77 \times 0.74) \times 2$	$= 0.62$
$1.35 \times 0.77 \times 0.74$	$= 0.85$
$0.72 \times 0.77 \times 0.81$	$= 0.45$

SOUTH:

$$2.40 \times 0.77 \times 0.35 = 0.65$$

$$(1.35 \times 0.77 \times 0.31) \times 2 = 0.64$$

WEST:

$$2.40 \times 0.77 \times 0.77 = \underline{1.42}$$

TOTAL = 6.54 (<10.07)

ARTIFICIAL VENTILATION:

ENERGY INDEX:

NORTHERN FAÇADE: $13.26 \times 2.550 = 33.81$
 $33.81 \times 0.221 = 7.47$

EASTERN FAÇADE: F1 $3.4 \times 2.550 = 8.67$
 $8.67 \times 0.221 = 1.92$

F2: $9.62 \times 2.550 = 24.53$
 $24.53 \times 0.221 = 5.42$

SOUTHERN FAÇADE: $13.26 \times 2.550 = 33.81$
 $33.81 \times 0.221 = 7.47$

WESTERN FAÇADE: $9.62 \times 2.550 = 24.53$
 $24.53 \times 0.221 = 5.42$

NORTHERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 5.04[0.77(0.00 \times 1.00 + 1.01 \times 0.92) + 0.01 \times 5.6] \\ &= 5.04[0.77(0.00 + 0.93) + 0.06] \\ &= 5.04[0.77(0.93) + 0.06] \\ &= 5.04[0.72 + 0.06] \\ &= 5.04 \times 0.78 \\ &= 3.93 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 2.4[0.77(0.00 \times 1.00 + 1.01 \times 0.77) + 0.01 \times 5.6] \\ &= 2.4[0.77(0.00 + 0.78) + 0.06] \\ &= 2.4[0.77(0.78) + 0.06] \\ &= 2.4[0.60 + 0.06] \\ &= 2.4 \times 0.66 \\ &= 1.58 \end{aligned}$$

$$3.93 + 1.58 = 5.51 (<7.47 \checkmark)$$

EASTERN FAÇADE:

F1

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 0.72[0.77(0.00 \times 1.00 + 1.08 \times 0.85) + 0.01 \times 5.6] \\ &= 1.35[0.77(0.00 + 0.92) + 0.06] \\ &= 1.35[0.77(0.92) + 0.06] \\ &= 1.35(0.71 + 0.06) \\ &= 1.35 \times 0.77 \\ &= 1.04 (<1.92 \checkmark) \end{aligned}$$

F2

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 1.35[0.77(0.00 \times 1.00 + 1.08 \times 0.73) + 0.01 \times 5.6] \\ &= 1.35[0.77(0.00 + 0.79) + 0.06] \\ &= 1.35[0.77(0.79) + 0.06] \\ &= 1.35(0.61 + 0.06) \\ &= 1.35 \times 0.67 \\ &= 0.90 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 0.54[0.77(0.00 \times 1.00 + 1.08 \times 0.73) + 0.01 \times 5.6] \\ &= 0.54[0.77(0.00 + 0.79) + 0.06] \\ &= 0.54[0.77(0.79) + 0.06] \\ &= 0.54(0.61 + 0.06) \\ &= 0.54 \times 0.67 \\ &= 0.36 \end{aligned}$$

$$2 \text{ Windows} = 0.36 \times 2 = 0.72$$

$$0.90 + 0.72 = 1.62 \text{ (<5.42 } \checkmark)$$

SOUTHERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 2.4[0.77(0.00 \times 1.00 + 0.41 \times 0.84) + 0.01 \times 5.6] \\ &= 2.4[0.77(0.00 + 0.34) + 0.06] \\ &= 2.4[0.77(0.34) + 0.06] \\ &= 2.4(0.26 + 0.06) \\ &= 2.4 \times 0.32 \\ &= 0.77 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 1.35[0.77(0.00 \times 1.00 + 0.41 \times 0.77) + 0.01 \times 5.6] \\ &= 1.35[0.77(0.00 + 0.32) + 0.06] \\ &= 1.35[0.77(0.32) + 0.06] \\ &= 1.35(0.25 + 0.06) \\ &= 1.35 \times 0.31 \\ &= 0.42 \end{aligned}$$

$$2 \text{ Windows} = 0.42 \times 2 = 0.84$$

$$0.77 + 0.84 = 1.61 (< 7.47 \checkmark)$$

WESTERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 2.4[0.77(0.00 \times 1.00 + 1.01 \times 0.85) + 0.01 \times 5.6] \\ &= 2.4[0.77(0.00 + 0.86) + 0.06] \\ &= 2.4[0.77(0.86) + 0.06] \\ &= 2.4(0.66 + 0.06) \\ &= 2.4 \times 0.72 \\ &= 1.73 (<5.42 \checkmark) \end{aligned}$$

BUILDING SUITABLE FOR AIRCONDITIONING / MECHANICAL VENTILATION

LIGHTING

ENERGY DEMAND:

ALLOWED: $5\text{W}/\text{m}^2$

$$5\text{W}/\text{m}^2 \times 121.92\text{m}^2 = 609.60\text{W}$$

$$11 \times 11\text{W lamps} + 2 \times 32\text{W lamps} = 185\text{W} (< 609.60\text{W} \checkmark)$$

or

$$185\text{W} / 121.92\text{m}^2 = 1.52\text{W}/\text{m}^2 (< 5\text{W}/\text{m}^2)$$

ENERGY CONSUMPTION:

ALLOWED: $5\text{kWh/m}^2.\text{a}$ or 5kWh/m^2 [$a = 1$ (year)]

$$5\text{kWh/m}^2.\text{a} \times 121.92\text{m}^2 = 609.60\text{kWh.a}$$

Assume lights are on from 17:00 – 22:00 each day/year

That is 5h/day

$$52 \text{ (weeks)} \times 7 \text{ (days)} \times 5 \text{ (h)} = 1\,820\text{h.a}$$

$$\begin{aligned} \text{There are } 11 \times 11\text{W lamps, } 2 \times 32\text{W lamps} &= (11 \times 11\text{W}) + (2 \times 32\text{W}) \\ &= 121\text{W} + 64\text{W} \\ &= 185\text{W} \\ &= 0.185\text{kW} \end{aligned}$$

$$0.185\text{kW} \times 1\,820\text{h.a} = 336.7\text{kWh.a} (< 609.60\text{kWh.a} \checkmark)$$