


ZONE 5



Conductance:
SHG:

A x U 
A x S x E

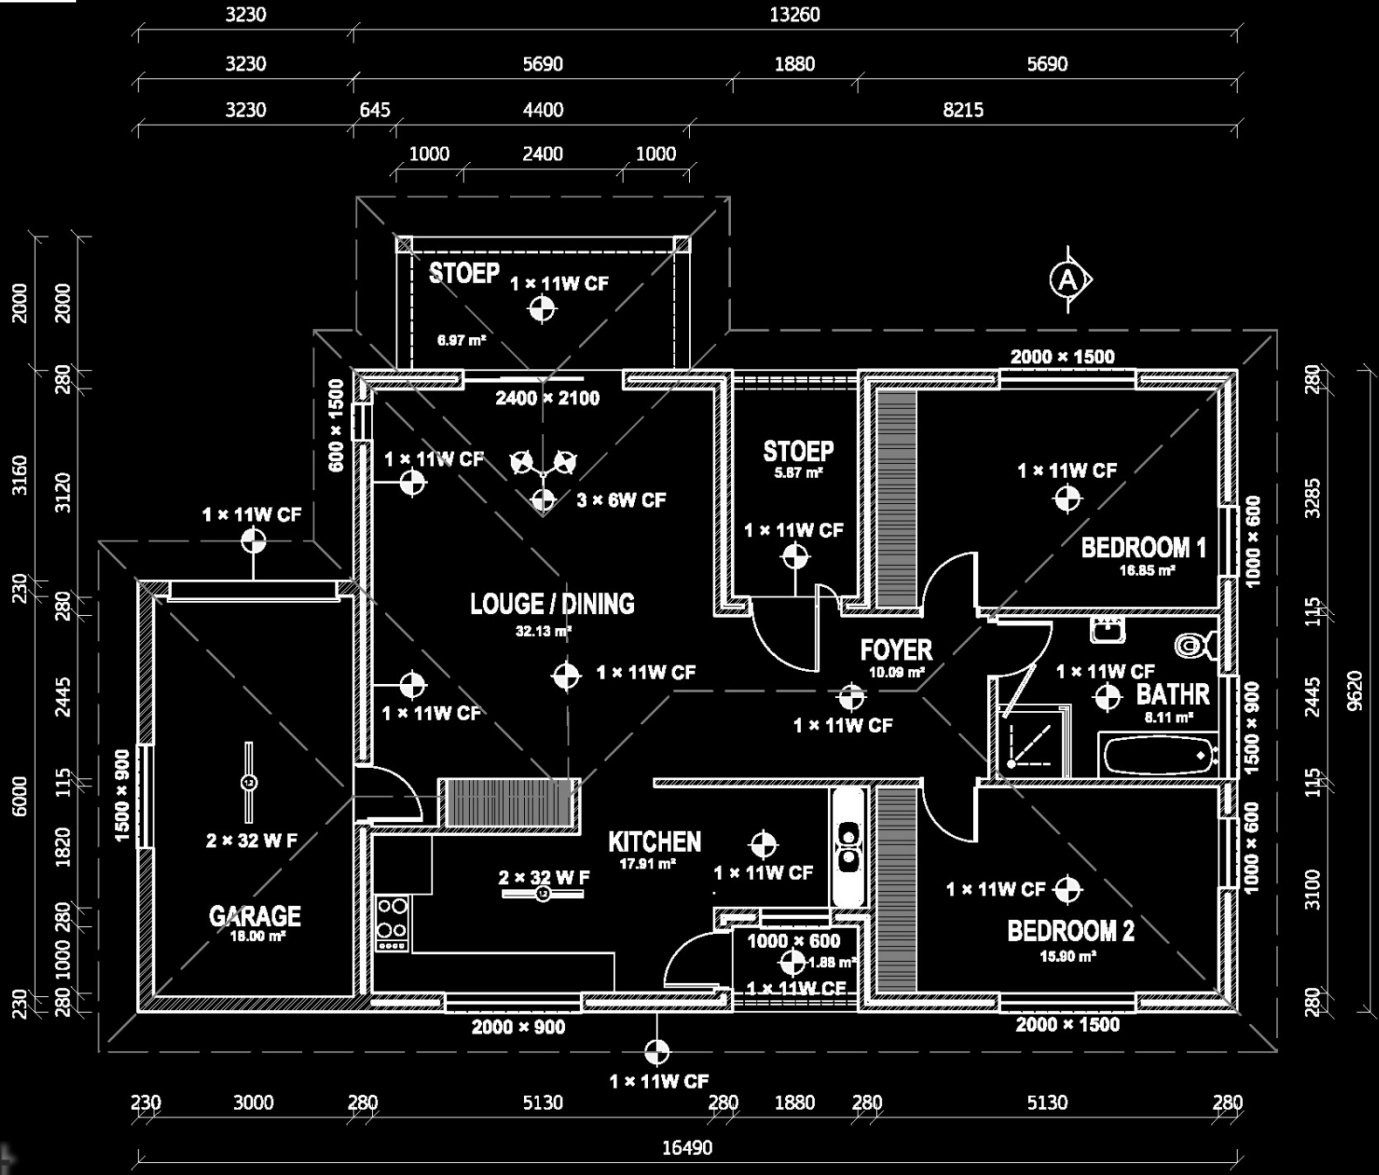

NATURAL VENTILATION

CHECK FOR COMPLIANCE WITH 10400XA

NET FLOOR AREA: 100.99m²

GLAZING AREA:

$$2.4 \times 2.1 = 5.04$$

$$2 \times 1.5 \times 2 = 6.00$$

$$0.6 \times 1.0 \times 3 = 1.80$$

$$1.5 \times 0.9 = 1.35$$

$$2.0 \times 0.9 = 1.80$$

$$0.6 \times 1.5 = \underline{0.90}$$

16.89

$$16.89/100.99 \times 100 = 16.72\%$$

Do not comply with max of 15% as per SANS10400XA



CONSTANTS:

$$\text{CONDUCTANCE:} \quad 100.99 \times 1.4 = 141.39$$

$$\text{SHG:} \quad 100.99 \times 0.11 = 11.11$$

CONDUCTANCE:

Use clear glass in wooden frame

$$\begin{aligned} A \times U &= 16.89 \times 5.6 \\ &= 94.58 \quad (< 141.39 \checkmark) \end{aligned}$$

SOLAR HEAT GAIN:

$$P_1 = 600 + 115 = 715, \quad P_2 = 600 + 115 + 1280 = 1995;$$

$$P_3 = 1000 + 600 = 1600$$

$$G = 2270 - 2100 = 170 \quad (< 500)$$



2100 Door:	$P/H = 1600/2270 = 0.70$
1500 Window:	$P/H = 715/1670 = 0.43$
900 Window:	$P/H = 715/1070 = 0.67$
600 Window ₁ :	$P/H = 715/770 = 0.93$
600 Window ₂ :	$P/H = 1995/770 = 2.59$

NORTH:

$$5.04 \times 0.77 \times 0.24 = 0.93$$

$$3.00 \times 0.77 \times 0.30 = 0.69$$

EAST:

$$(0.60 \times 0.77 \times 0.49) \times 2 = 0.45$$

$$1.35 \times 0.77 \times 0.66 = 0.69$$

SOUTH:

$$3.00 \times 0.77 \times 0.42 = 0.97$$

$$1.80 \times 0.77 \times 0.34 = 0.47$$

$$0.60 \times 0.77 \times 0.16 = 0.07$$

WEST:

$$0.90 \times 0.77 \times 0.83 = \underline{0.58}$$

$$\text{TOTAL} = 4.85 (<11.11)$$

$$A_1 [S_1 (C_A \times S_{H1} + C_B \times S_{C1}) + C_C \times U_1]$$

$A_{1,2,3}$ is the area of each glazing element

$C_{A,B,C}$ are the energy constants in table D1

$S_{1,2,3}$ is the SHGC of each glazing element in Table 6

$S_{H1,H2,H3}$ is the heating shading multiplier for each value element given in table D2

$S_{C1,C2,C3}$ is the cooling shading multiplier for each value element given in table D3

$U_{1,2,3}$ is the total U-value of each glazing element given in table 6

2100 Door: $P/H = 1600/2270 = 0.70$

1500 Window: $P/H = 715/1670 = 0.43$

900 Window: $P/H = 715/1070 = 0.67$

600 Window₁: $P/H = 715/770 = 0.93$

600 Window₂: $P/H = 1995/770 = 2.59$

$$G = 2270 - 2100 = 170 (<500)$$



ARTIFICIAL VENTILATION:

ENERGY INDEX:

NORTHERN FAÇADE: $13.26 \times 2.550 = 33.81$
 $33.81 \times 0.180 = 6.09$

EASTERN FAÇADE: $9.62 \times 2.550 = 24.53$
 $24.53 \times 0.180 = 4.42$

SOUTHERN FAÇADE: $13.26 \times 2.550 = 33.81$
 $33.81 \times 0.180 = 6.09$

WESTERN FAÇADE: $9.62 \times 2.550 = 24.53$
 24.53×0.180

NORTHERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 5.04[0.77(0.00 \times 1.00 + 0.80 \times 0.54) + 0.02 \times 5.6] \\ &= 5.04[0.77(0.00 + 0.43) + 0.11] \\ &= 5.04[0.77(0.43) + 0.11] \\ &= 5.04[0.33 + 0.11] \\ &= 5.04 \times 0.44 \\ &= 2.22 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 3[0.77(0.00 \times 1.00 + 0.80 \times 0.72) + 0.02 \times 5.6] \\ &= 3[0.77(0.00 + 0.58) + 0.11] \\ &= 3[0.77(0.58) + 0.11] \\ &= 3[0.45 + 0.11] \\ &= 3 \times 0.56 \\ &= 1.68 \end{aligned}$$

$$2.22 + 1.68 = 3.90 (<6.09 \checkmark)$$



EASTERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 1.35[0.77(0.00 \times 1.00 + 0.91 \times 0.73) + 0.02 \times 5.6] \\ &= 1.35[0.77(0.00 + 0.66) + 0.11] \\ &= 1.35[0.77(0.66) + 0.11] \\ &= 1.35(0.51 + 0.11) \\ &= 1.35 \times 0.62 \\ &= 0.84 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 0.6[0.77(0.00 \times 1.00 + 0.91 \times 0.63) + 0.02 \times 5.6] \\ &= 0.6[0.77(0.00 + 0.57) + 0.11] \\ &= 0.6[0.77(0.57) + 0.11] \\ &= 0.6(0.44 + 0.11) \\ &= 0.6 \times 0.55 \\ &= 0.33 \end{aligned}$$

$$2 \text{ Windows} = 0.33 \times 2 = 0.66$$

$$0.84 + 0.66 = 1.50 (<4.42 \checkmark)$$

SOUTHERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 3[0.77(0.00 \times 1.00 + 0.48 \times 0.84) + 0.02 \times 5.6] \\ &= 3[0.77(0.00 + 0.40) + 0.11] \\ &= 3[0.77(0.40) + 0.11] \\ &= 3(0.31 + 0.11) \\ &= 3 \times 0.42 \\ &= 1.26 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 1.8[0.77(0.00 \times 1.00 + 0.48 \times 0.77) + 0.02 \times 5.6] \\ &= 1.8[0.77(0.00 + 0.37) + 0.11] \\ &= 1.8[0.77(0.37) + 0.11] \\ &= 1.8(0.28 + 0.11) \\ &= 1.8 \times 0.39 \\ &= 0.70 \end{aligned}$$

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 0.6[0.77(0.00 \times 1.00 + 0.48 \times 0.54) + 0.02 \times 5.6] \\ &= 0.6[0.77(0.00 + 0.26) + 0.11] \\ &= 0.6[0.77(0.26) + 0.11] \\ &= 0.6(0.20 + 0.11) \\ &= 0.6 \times 0.31 \\ &= 0.19 \end{aligned}$$

$$1.26 + 0.70 + 0.19 = 2.15 (<6.09 \checkmark)$$

WESTERN FAÇADE:

$$\begin{aligned} A[S(C_A \times S_H + C_B \times S_C) + C_C \times U] &= 0.9[0.77(0.00 \times 1.00 + 0.88 \times 0.85) + 0.02 \times 5.6] \\ &= 0.9[0.77(0.00 + 0.75) + 0.11] \\ &= 0.9[0.77(0.75) + 0.11] \\ &= 0.9(0.58 + 0.11) \\ &= 0.9 \times 0.69 \\ &= 0.62 (<4.42 \checkmark) \end{aligned}$$

BUILDING SUITABLE FOR AIRCONDITIONING / MECHANICAL VENTILATION